

Discontinued
Contact Fulham for availability. Not for use in new designs.



FLPL50
Photoluminescent Exit Sign

Specifications


NO additional electrical or mechanical source required. Before installation, it must be determined that there is a minimum of 5Fc of LED or fluorescent light on the face(s) of the sign at all times during building occupancy.

UL 924 Emergency Lighting and Power Equipment Listed through ETL;
Meets NFPA Life Safety Code 101 and OSHA requirements;
Meets International Building and Fire Codes
Listed through UL 924 for the USA and Canada

Standard Features

- High Illumination Non-Electric Photoluminescent Technology
- Non-Radioactive, Non-Toxic
- Thin, Low Profile Construction
- Long Life Corrosion-Proof Construction (20 Yrs. Est.)
- High Visibility In Total Darkness And Smoke Filled Conditions
- Field Applied Directional Chevrons
- Suitable For Floor Proximity Installation
- Consistent, Uniform Illumination
- 50 Ft Viewing Distance
- Aluminum Construction With Photoluminescent Lettering
- Lead Points Qualified
- Both High And Low Location Approved
- Replacement Can Be Relocated If Path Of Egress Changes
- Designed For Surface, Flag And Ceiling Mount With Optional frame and mounting bracket.
- Requires Virtually No Maintenance – No Bulbs, No Battery

Mechanical Data

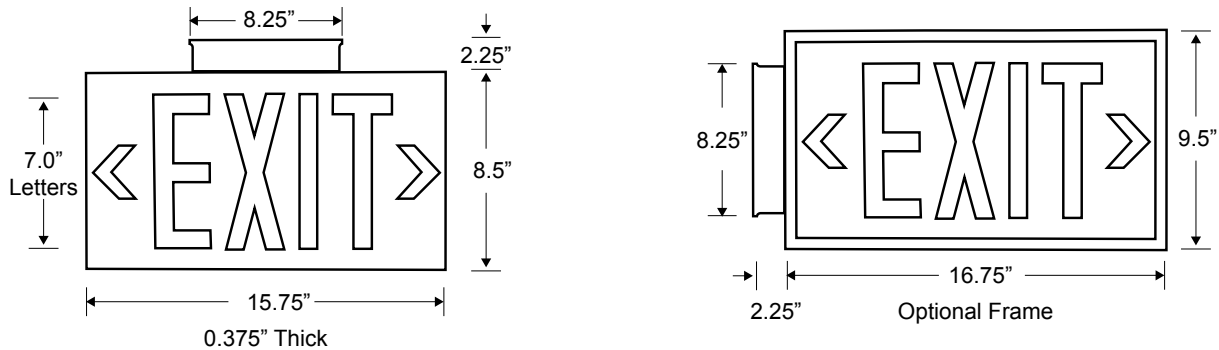

Multiple mounting options shown.

Part Number Matrix

FLPL50

S

Number of Faces
S = Single
D = Dual

G

Background Color
G = Green
R = Red

B

Frame Color
W = White
Blank = No Frame