



FLPL75

Photoluminescent Exit Sign

Specifications


NO additional electrical or mechanical source required. Before installation, it must be determined that there is a minimum of 5Fc of LED or fluorescent light on the face(s) of the sign at all times during building occupancy.

Listed through UL 924 for the USA and Canada
Meets NFPA Life Safety Code 101 and OSHA requirements;
Meets International Building and Fire Codes
Listed with the State of California State Fire Marshal

Standard Features

- Red Or Green Letters On Photoluminescent Background
- Non-Radioactive, Non-Toxic
- Thin, Low Profile Construction
- No Energy Consumption
- Field Directional Chevrons Indicators
- Suitable For Floor Proximity Installation
- Consistent, Uniform Illumination
- Visible At 75 Feet
- Leed Points Qualified
- Both High And Low Location Approved
- Can Be Relocated If Path Of Egress Changes
- Designed For Surface, Flag And Ceiling Mount With Optional frame and mounting bracket.
- Requires Virtually No Maintenance – No Bulbs, No Battery

Mechanical Data

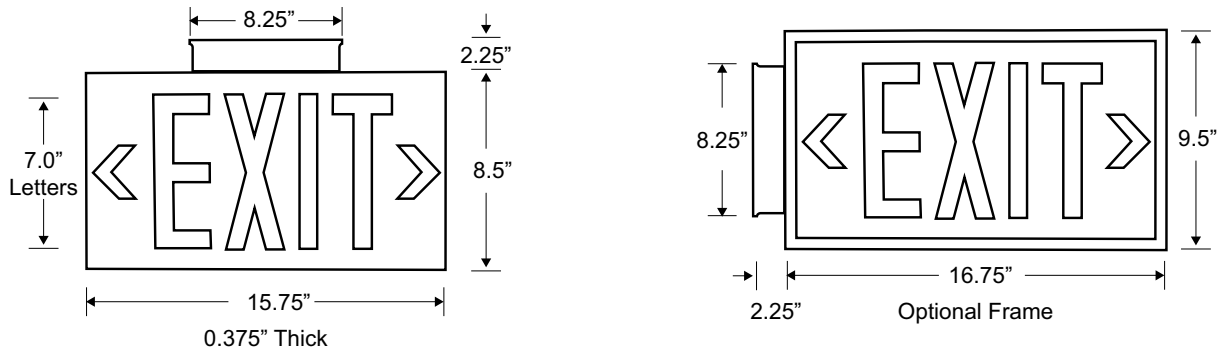

Multiple mounting options shown.

Part Number Matrix

FLPL75

S

Number of Faces
S = Single
D = Dual

G

Letter Color
G = Green
R = Red

B

Frame Color
B = Black
S = Silver Powder Coat
W = White
Blank = No Frame